



**CRAWL SPACE TYPE D -- MECHANICAL**  
 SCALE: 1/4" = 1'-0"

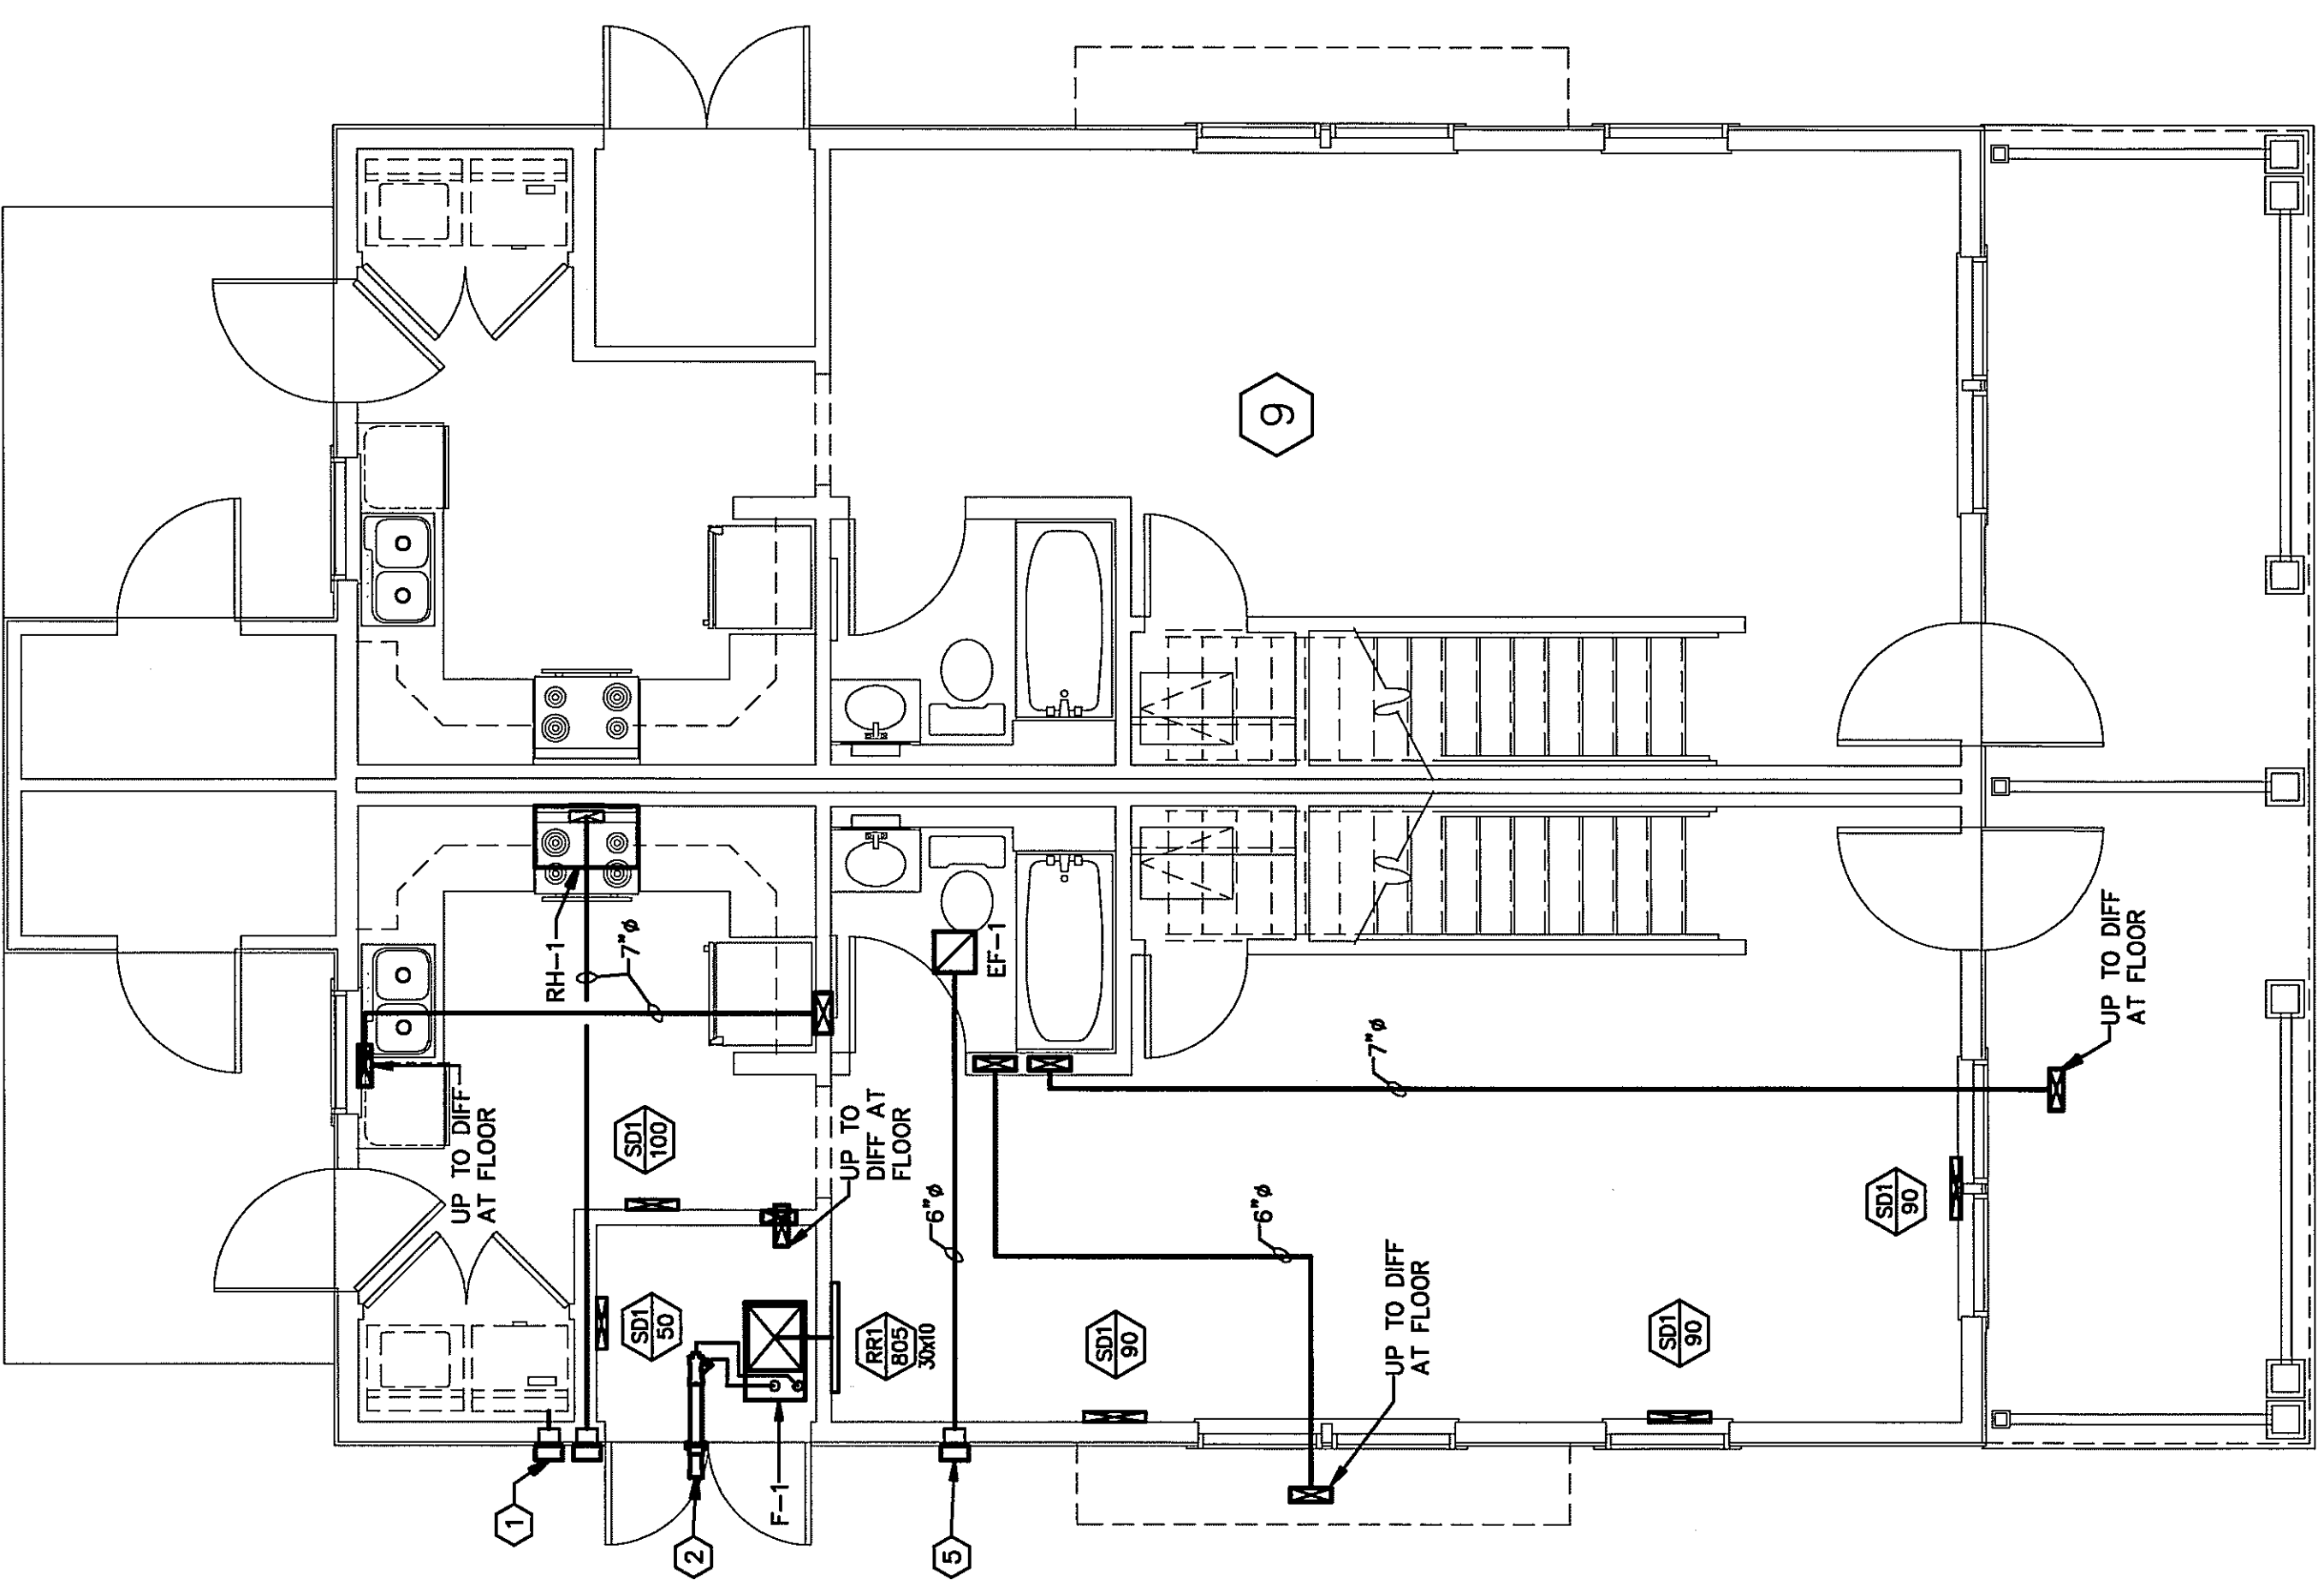

**FIRST FLOOR TYPE D -- MECHANICAL**  
 SCALE: 1/4" = 1'-0"

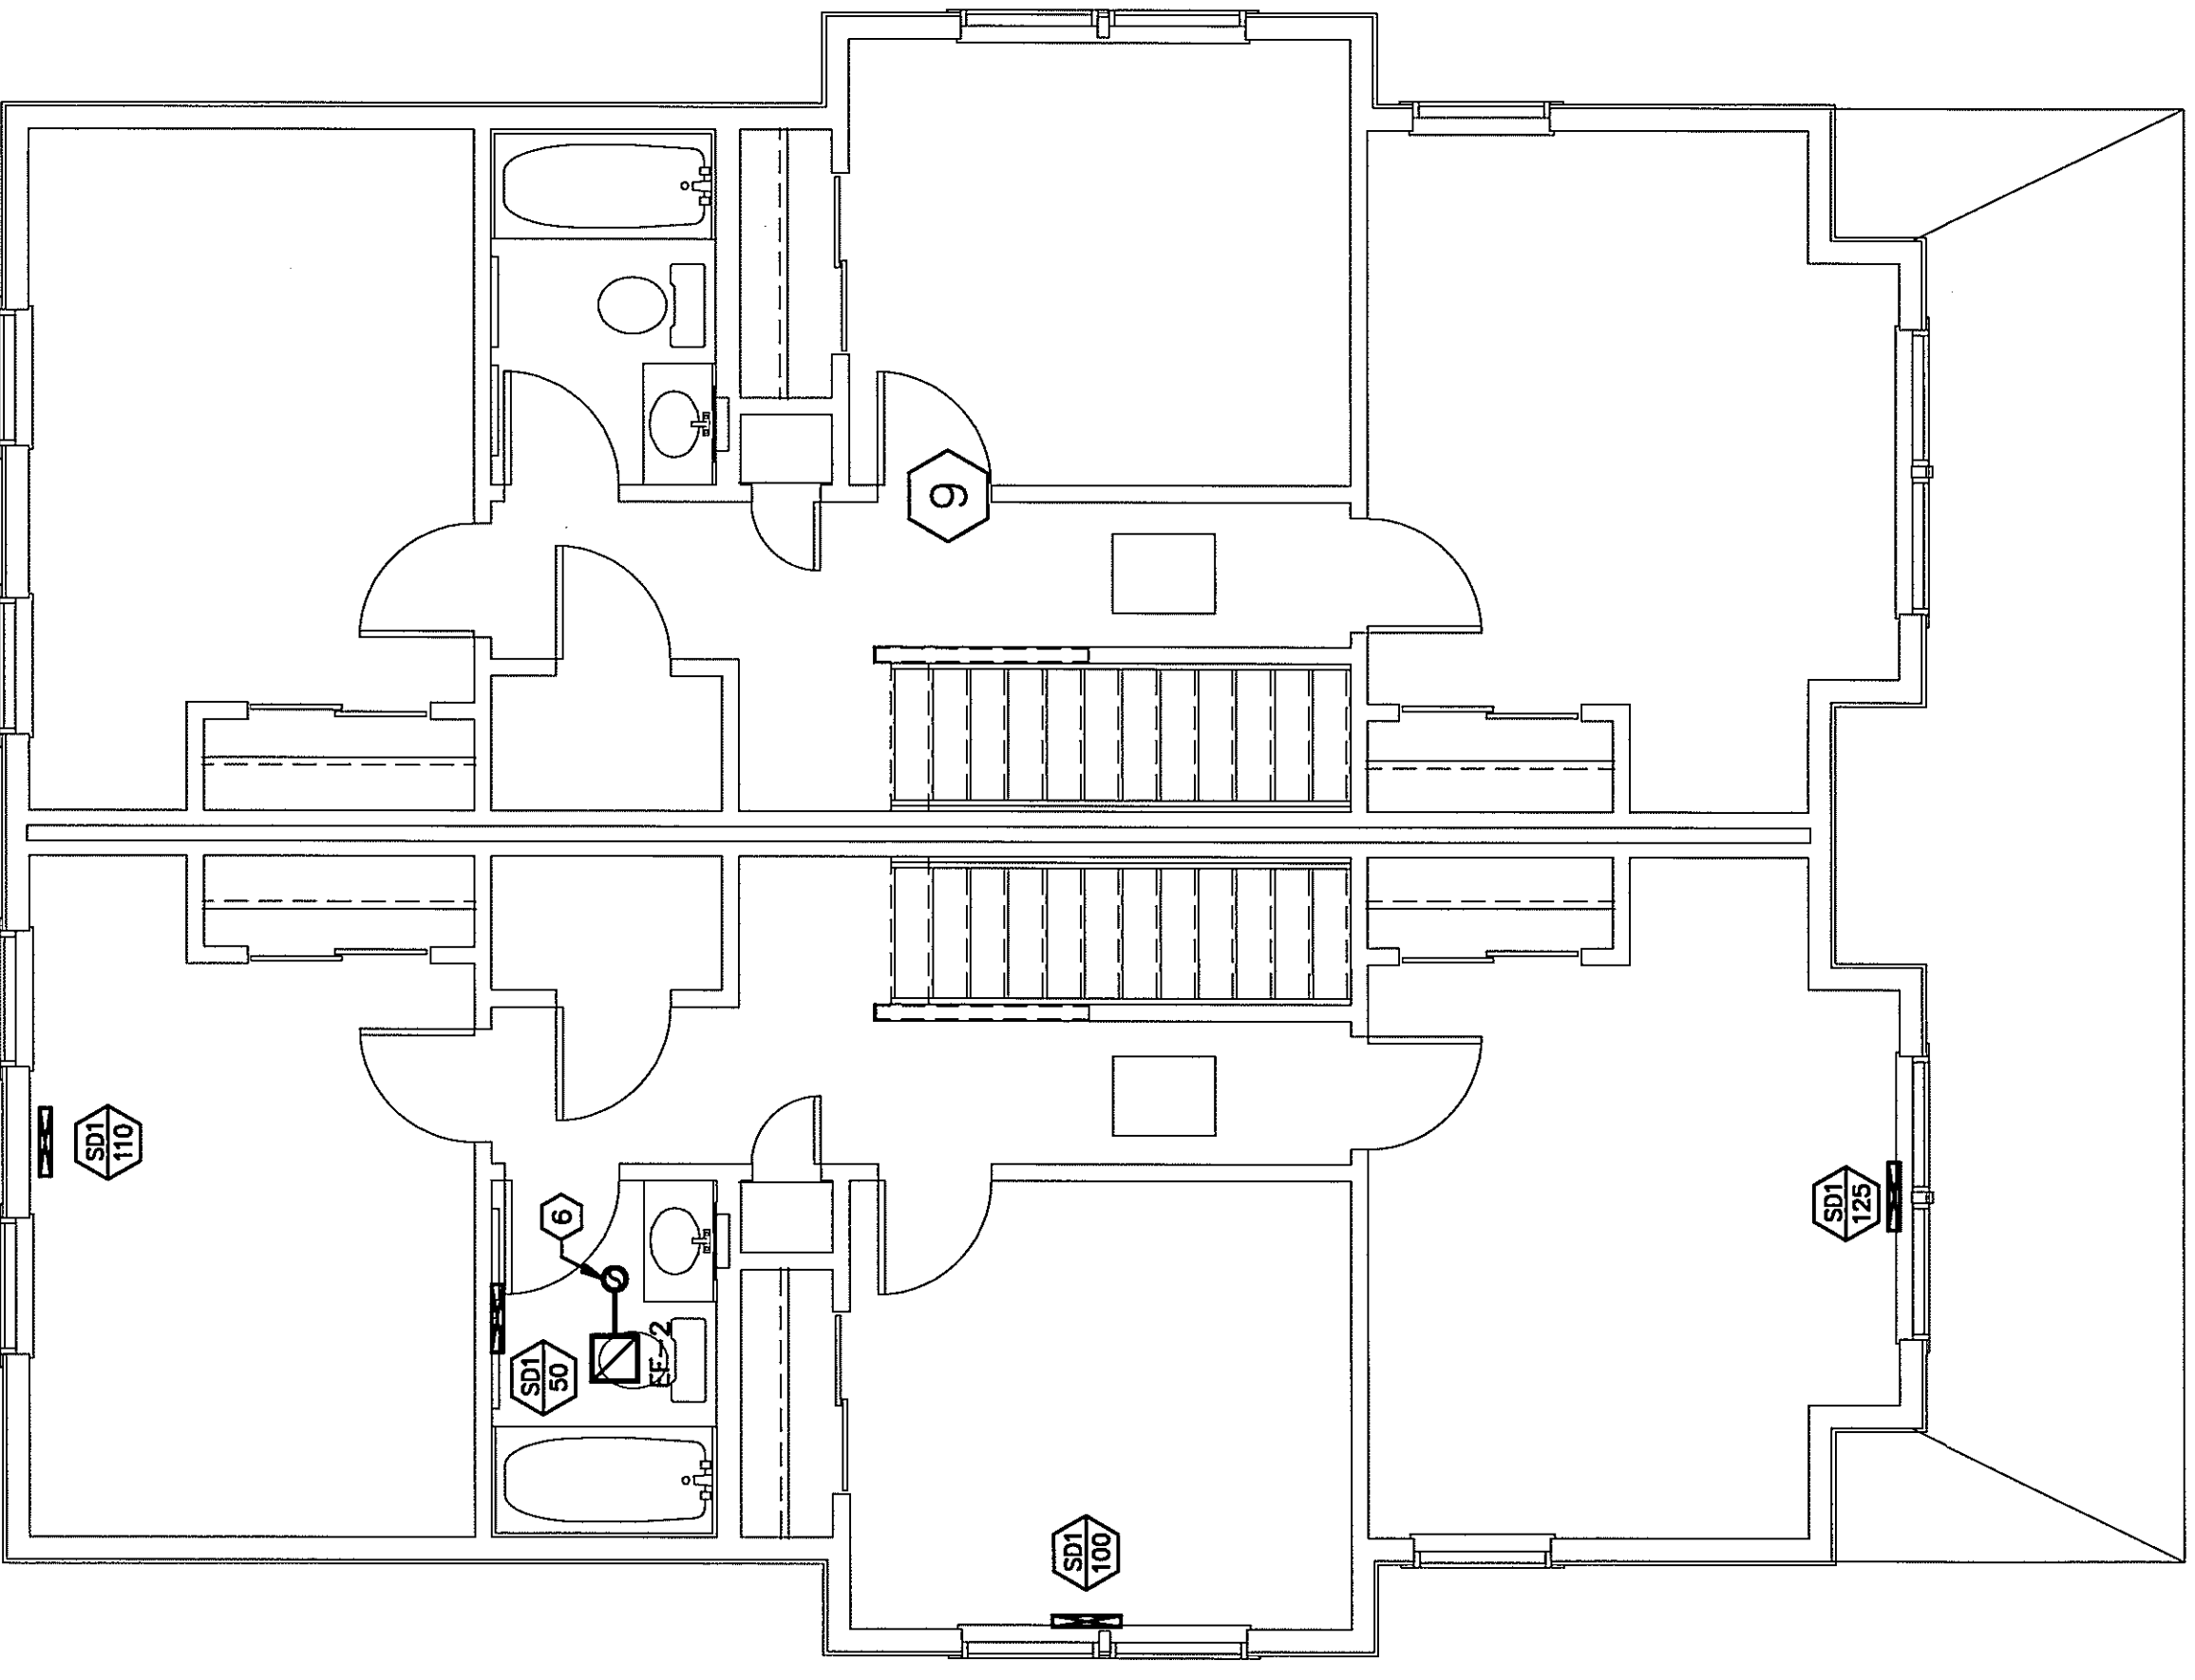

**SECOND FLOOR TYPE D -- MECHANICAL**  
 SCALE: 1/4" = 1'-0"

- PLAN NOTES**
1. DRYER VENT DISCHARGE COORDINATE EXACT LOCATION WITH EQUIPMENT.
  2. CONCENTRIC FLUE TERMINATION KIT.
  3. FLOOR MOUNTED DIFFUSER. TYPICAL.
  4. DUCT ABOVE FIRST FLOOR CEILING SERVING THE SECOND FLOOR UNIT. FIRESTOP AROUND ALL FLOOR PENETRATIONS.
  5. DISCHARGE CAP FOR EXHAUST TERMINATION. SEE EXHAUST FAN SCHEDULE FOR EXHAUST TERMINATION.
  6. EXHAUST DUCT UP TO PITCHED ROOF CAP WITH BIRD SCREEN AND BACKDRAFT DAMPER.
  7. PROVIDE PRE-CHARGED, CAPPED, REFRIGERANT LINE SET FOR FUTURE COOLING. SIZED PER MANUFACTURER'S RECOMMENDATIONS FOR TONS OF COOLING. USE 1/2" DIA. AT CONNECTIONS. PIPING INTO CRAWL SPACE AND MECHANICAL ROOM. DO NOT CUT PIPING OR EXPOSE TO ATMOSPHERE.
  8. RETURN REGISTER HIGH IN WALL. MOUNT AT 1" BELOW CEILING TO TOP EDGE OF REGISTER.
  9. RIGHT SIDE IS MIRROR IMAGE OF LEFT.